

# Greentrol Automation, Inc.

*Installation, Operation and Maintenance Technical Manual*

## **GS-200-N/RH/T**

**RELATIVE HUMIDITY AND TEMPERATURE Sensor for RS-485  
BACnet and Modbus RTU Applications**

Document Name: TM\_GS-200-N/RH/T\_R1C

TM\_GS-200N/RH/T\_R1B



Part Number: 960-0350

**LIST OF EFFECTIVE AND CHANGED PAGES**

Insert latest changed pages (in bold text); remove and dispose of superseded pages.  
Total number of pages in this manual is **18**.

Page	Rev *	Description of Change	Date	Page	Rev *	Description of Change	Date
1,2	R1C	Updated to revision R1C .....	11/28/2011	1-18	R1A	Initial Document Release .....	04/19/2010
1,4, 13	R1C	Removed OEM references .....	11/28/2011				
16	R1B	Added Modbus Data detail (8/1/No parity) .....	09/26/2011				

\* R1A indicates an original page without change

**Table of Contents**

OVERVIEW .....	.3	GS-200 START-UP .....	.13
ADVANCED TECHNOLOGY .....	.3	GS-200 NORMAL OPERATION .....	.13
SPECIFICATIONS .....	.4	GS-200 MAINTENANCE .....	.13
ORDERING GUIDE .....	.4	GREENTROL STANDARD LIMITED PARTS WARRANTY .....	.13
GS-200 PLACEMENT CONSIDERATIONS .....	.5	APPENDIX A - BACnet NETWORK DEVICE OPERATING	
GS-200 INSTALLATION .....	.6	PARAMETERS .....	.14
GS-200 INTERCONNECTIONS .....	.8	GS-200 BACNET OVERVIEW .....	.14
GS-200 SET UP .....	.10	BACnet Device Object .....	.14
GS-200 BACnet CONFIGURATION .....	.10	BACnet Analog Input (AI) Objects .....	.14
J1 - GS-200 RS485 Network Termination Selection .....	.10	BACnet Analog Value Objects .....	.15
Setting GS-200 Time .....	.10	BACnet Binary Value Objects .....	.15
SW1 - GS-200 Configuration DIP Switch Settings .....	.10	APPENDIX B - MODBUS NETWORK DEVICE OPERATING	
Setting the MAC Address .....	.11	PARAMETERS .....	.15
Changing BACnet Device Object Instance Number .....	.11	GS-200 Modbus Register Overview .....	.16
Setting the MS/TP Baud Rate .....	.12	Modbus 4-Byte Floats - Read Only Properties .....	.16
Restoring Factory Default Settings .....	.12	Modbus 4-Byte Floats - Read/Write Properties .....	.16
GS-200 MODBUS CONFIGURATION .....	.12	Modbus 2-Byte Registers - Read/Write Properties .....	.16

**List of Figures**

Figure 1. GreenTrol GS-200 - RH/Temperature Wall Mount BACnet®/Modbus® RTU Sensor .....	.3
Figure 2. GS-200 Outline Dimensions .....	.5
Figure 3. Marking Locations for Installation .....	.7
Figure 4. GS-200 Typical Wiring Diagram to BAS Control Interface .....	.8
Figure 5. GS-200 Interior Detail View .....	.9
Figure 6. SW1 - Configuration DIP Switch Detail View .....	.11
Figure 7. MAC Address Selection Settings .....	.11
Figure 8. Baud Rate Selection Settings .....	.12

**List of Tables**

Table A1. BACnet® Device Object .....	.14
Table A2. BACnet® Analog Input (AI) Objects .....	.14
Table A3. BACnet® Analog Value Objects .....	.15
Table A4. BACnet® Binary Value Objects .....	.15
Table B1. GS-200 Supported Standard Modbus® Command Functions .....	.16
Table B2. Modbus® 4-Byte Floats - Read-Only Properties .....	.16
Table B3. Modbus® 4-Byte Floats - Read/Write Properties .....	.17
Table B4. Modbus® 2-Byte Registers - Read/Write Properties .....	.17

Copyright® 2010 GreenTrol, Inc.

All brand names, trademarks and registered trademarks are the property of their respective owners. Information contained within this document is subject to change without notice. Visit [GreenTrol.com](http://GreenTrol.com) to view and/or download the most recent versions of this and other documents.

All rights reserved.

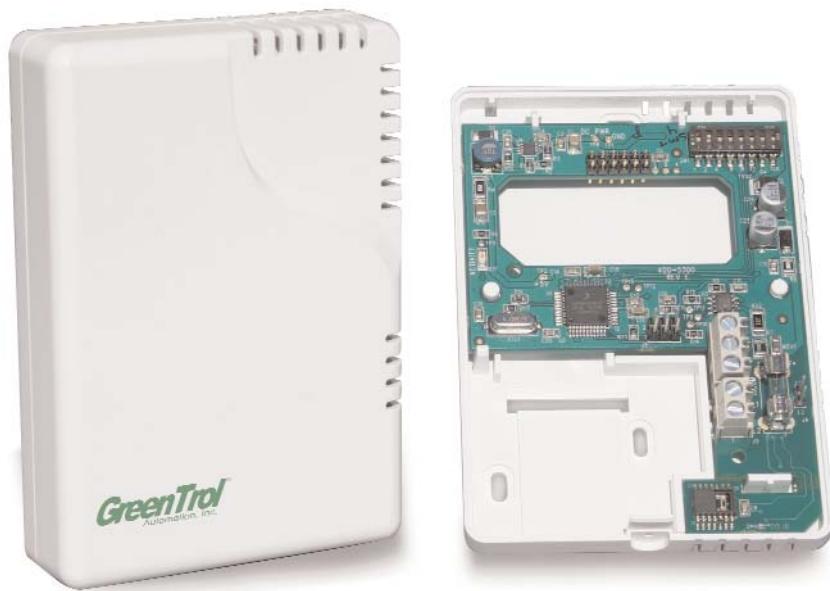


Figure 1. GreenTrol GS-200 - RH/Temperature Wall Mount BACnet/Modbus RTU Sensor

## OVERVIEW

GreenTrol's GS-200-N/RH/T is an innovative wall mount relative humidity (RH)/temperature sensor that provides precision measurement and BACnet® MS/TP or Modbus® RTU communications interface in a single device packaged for interoperability with modern building automation systems (BAS).

The integral RS-485 BACnet MS/TP and Modbus RTU compatible communications interface includes options for setting address, device instance and baud rate. Coupled with complementary precision relative humidity and temperature sensors, the GS-200 provides an economical, simple and intelligent alternative to harnessing and coordinating the network operation of individual relative humidity and temperature sensor devices.

Simple field configuration is accomplished by DIP switches on the main circuit board and via the BACnet and Modbus RTU interface.

## ADVANCED TECHNOLOGY

- Single BACnet/Modbus RTU device features integrated complement of precision sensing elements for Relative Humidity and Temperature measurement.
- Integral RS-485 BACnet MS/TP and Modbus RTU interface for interoperability with common BAS devices.
- Microprocessor-based electronics with industrial grade integrated circuits.
- Convenient DIP switch user interface for simple field configuration.

### Network Connectivity Solutions



**Modbus®**

## SPECIFICATIONS

### Sensor Complement

- Advanced precision sensing elements for relative humidity and temperature measurement via RS-485 BACnet MS/TP and Modbus RTU communication interface

### Relative Humidity Sensor Performance

- Technology: Planar Capacitive Polymer
- RH Range: 0 to 100% RH, non condensing
- RH Accuracy:  $\pm 2\%$  @ 20% to 80% RH, 77°F (25°C)  
 $\pm 3\%$ : <20% to >80% RH, 77°F (25°C)
- RH Resolution: 0.4% RH

### Temperature Sensor Performance

- Technology: Integral band gap PTAT
- Range: -58°F to 302°F (-50°C to 150°C)
- Accuracy:  $\pm 1.08\text{°F}$  at 77°F ( $\pm 0.6\text{°C}$  at 25°C)
- Resolution: 0.36°F (0.2°C)

**Signal Processing:** Microprocessor-based

### Power Supply Performance

- Technology: Integral power supply powered by external 24 VAC (22.8-26.4VAC), 50/60 Hz source.
- Brownout Watchdog protection reset circuit
- Oversupply, overcurrent, and surge protection

### Enclosure

- Attractive low profile wall mount enclosure compatible with standard single-gang electrical box, and surface mount applications.

### Dimensions

- 4.650 x 3.250 x 1.090 in (118.11 x 82.55 x 27.69 mm)

### User Interface

- Simple DIP switch selection

### Output to Host Controls

- RS-485 BACnet MS/TP or Modbus RTU
- Baud rate: Selectable 76,800, 38,400, 19,200, 9,600  
Default: RS-485 BACnet MS/TP 76,800  
Default: Modbus RTU: 19,200

### System Diagnostics

- On board LED status indicator

### Environmental Limits

- Operating Temperature: 32° F to 122° F (0° C to 50° C)
- Moisture: 0 to 95% RH, noncondensing

### Limited Warranty

- GreenTrol* products are warranted for 12 months from shipment as described in the Terms and Conditions of Sale.

## ORDERING GUIDE

Order *GreenTrol* model number **GS-200-N/RH/T**.

## GS-200 PLACEMENT CONSIDERATIONS

Figure 2 details the mechanical outline dimensions of the GS-200. The location selected for the GS-200 is important to ensure accurate readings that are representative of the area to be monitored. Preferred mounting locations are:

- On an interior wall that has no direct sunlight exposure and is near (but not directly in the airstream of) a return air duct. In areas with multiple return air ducts, locate the sensor at a point between them, observing the same precautions. Avoid areas with poor air circulation, such as behind doors or in alcoves where temperature fluctuations and moisture accumulation can affect sensor performance. Also, avoid areas such as those located adjacent to water coolers, coffee machines, etc.
- At a height of 4 to 6 feet from floor level, and at least 3 feet from a corner and 2 feet from an open doorway.
- Away from the direct airflow of windows, doorways, halls or other heating and cooling sources.
- Away from other equipment that could affect the temperature of the sensor.

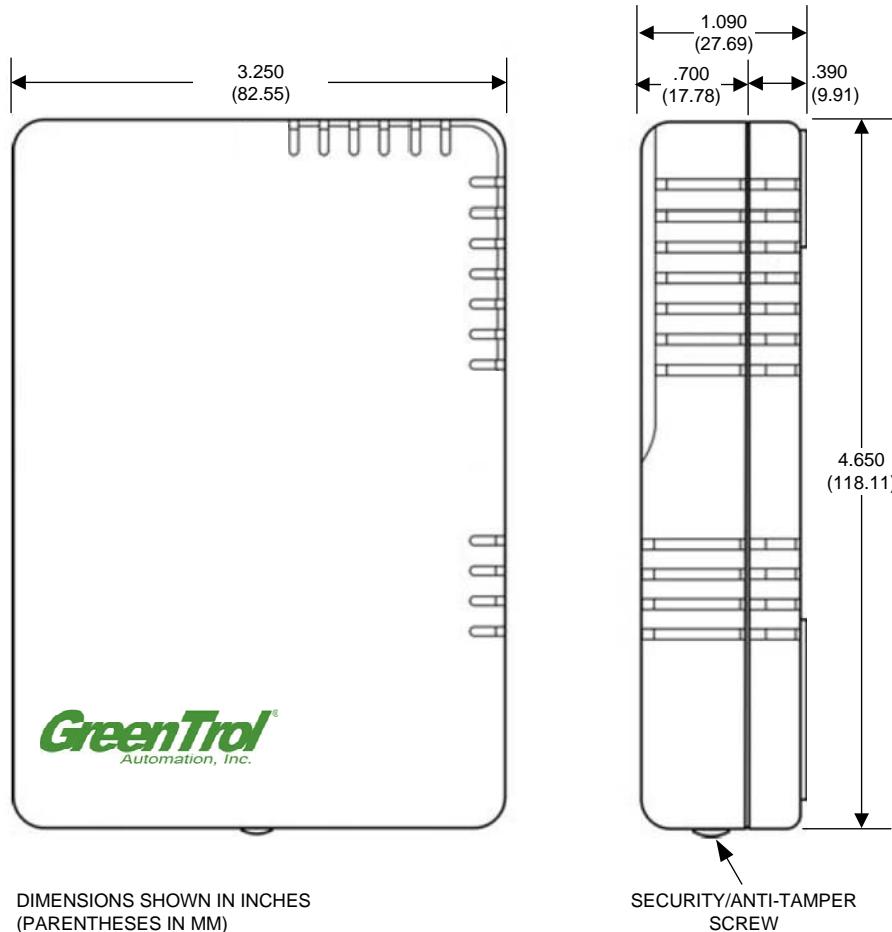


Figure 2. GS-200 Outline Dimensions

## GS-200 INSTALLATION

Read and understand all installation instructions prior to installing the GS-200. The GS-200 is designed for surface mount installation, or for installation onto a standard (field supplied) single gang electrical junction box. Installation and wiring of the GS-200 must be accomplished in accordance with all local electrical and mechanical codes to ensure safety and compliance. Refer to Figure 2 for GS-200 outline dimensions, and Figure 3 for mounting hole locations.

### CAUTION



Deactivate 24 VAC power source until all connections to the GS-200 are complete.



When multiple devices are powered from a common 24VAC power source, ensure that all devices are wired in phase with 24VAC power at L1, and 24VAC return at L2! Damage will occur to the GS-200 and/or other devices if this caution is not observed.



The GS-200 contains electrostatic discharge (ESD) sensitive components. To prevent damage, observe ESD precautions when handling the instrument. Failure to comply can result in equipment damage.



The installed location of the GS-200 is critical for proper performance. Refer to the previous GS-200 PLACEMENT CONSIDERATIONS section of this document for additional recommendations.



Ensure that adequate clearance exists to permit installation and wiring of the GS-200, and to allow for access to the board mounted instrument configuration switches.

1. Carefully open the GS-200 package and inspect for damage. If any damage is noted, immediately file a claim with carrier.
2. Determine the GS-200 installation location as indicated on the engineer's plans, or determine placement using the previous guidelines.
3. Install GS-200 wiring to the desired location, observing the previous placement considerations. Wiring may be routed directly through wall for surface mounting of the GS-200, or may be brought through a junction box depending upon local requirements. All wiring must be accomplished in accordance with local regulations and national codes.
4. Carefully remove the cover of the GS-200. Depress the enclosure tab at the bottom of the enclosure, and swing the cover upward to disengage it from the base. The GS-200 includes two mounting screws for standard electrical junction box installations, and one security/tamper resistant screw to secure the cover. After GS-200 installation and configuration is complete, this screw may be installed at the bottom of the enclosure to prevent inadvertent or unauthorized opening of the enclosure.
5. Using the GS-200 base as a template, mark the location for the wiring pass-through slot and for the mounting screws as shown in Figure 3. For mounting directly to a single-gang electrical junction box, proceed to step 8.
6. Drill holes sized for suitable wall anchors at the mounting locations marked, and install the wall anchors.
7. Drill another hole suitable to pass the GS-200 wiring through the wall at the marked wiring pass-through slot location. Pull wiring through hole, and allow 6 inches for wiring of the GS-200.
8. Pass GS-200 wiring through the rear pass-through opening of the GS-200 base and mount the instrument at the desired location using appropriate hardware for the mounting method selected. Refer to the proceeding sections of this document for initial instrument set up and normal operation.

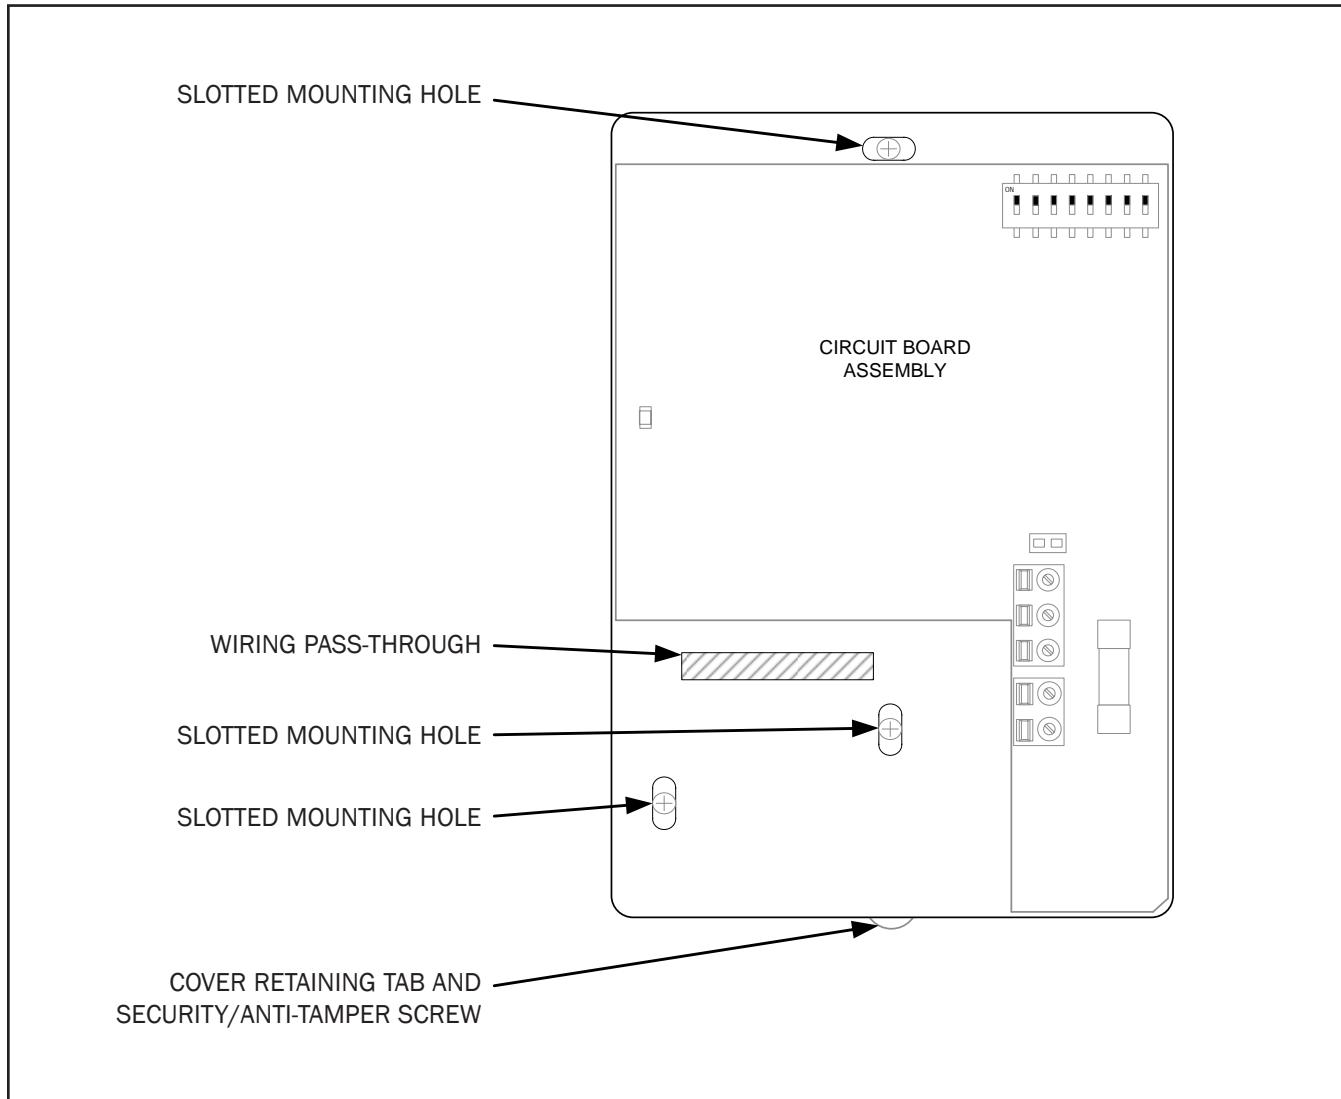


Figure 3. Marking Locations for Installation

## GS-200 INTERCONNECTIONS

### CAUTION

-  Deactivate 24 VAC power source until all connections to the GS-200 are complete.
-  When multiple devices are powered from a common 24VAC power source, ensure that all devices are wired in phase with 24VAC power at L1, and 24VAC return at L2! Damage will occur to the GS-200 and/or other devices if this caution is not observed.
-  The GS-200 contains electrostatic discharge (ESD) sensitive components. Observe ESD precautions when handling the instrument to prevent damage. Failure to comply can result in equipment damage.

All connections are accomplished on the GS-200 circuit board at terminal blocks J2 and J3 as shown in Figures 4 and 5.

1. Connect 24VAC power to the GS-200 at terminal block J3 terminals L1 and L2. When powering multiple network devices from a common source, observe 24VAC phasing (24VAC to L1, return at L2 - see Caution above).
2. The L2 post of the 24VAC J3 terminal block can be connected to earth ground according to the following:


### CAUTION

Damage to network devices may occur if L2 of the 24VAC J3 terminal block is connected to earth ground and the RS485 network is not earth grounded.


- a) If the RS485 network connection for the GS-200 is ground referenced to earth, the L2 post of the 24VAC J3 terminal block can also be connected to a wire that is ground referenced to earth.
- b) If the RS485 network connection for the GS-200 is not ground referenced to earth, then the L2 post of the 24VAC J3 terminal block must not be connected to a wire ground referenced to earth, as damage to other network devices may occur.

3. Connect the RS485 network connections at terminal block J2 as follows:

<u>J2 Terminal Block</u>	<u>Network Connection</u>
-	NET -
+	NET +
COM	NETWORK COMMON

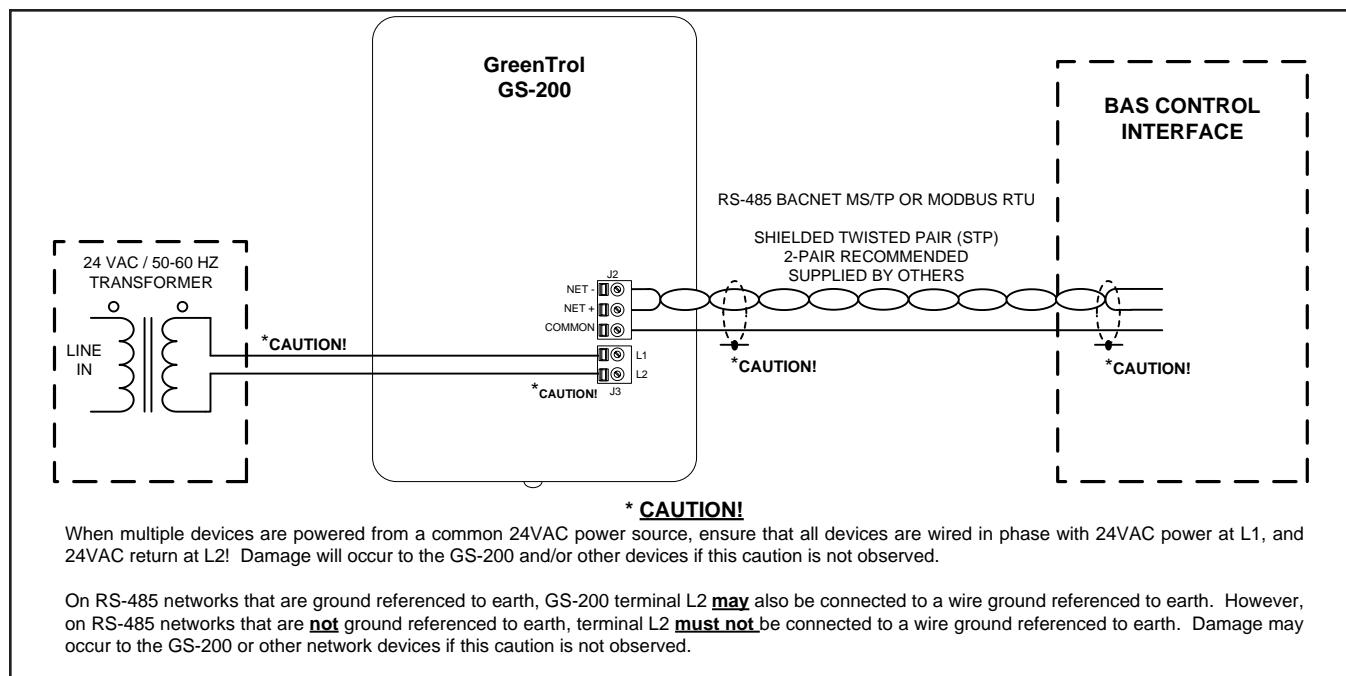

**Figure 4. GS-200 Typical Wiring Diagram to BAS Control Interface**

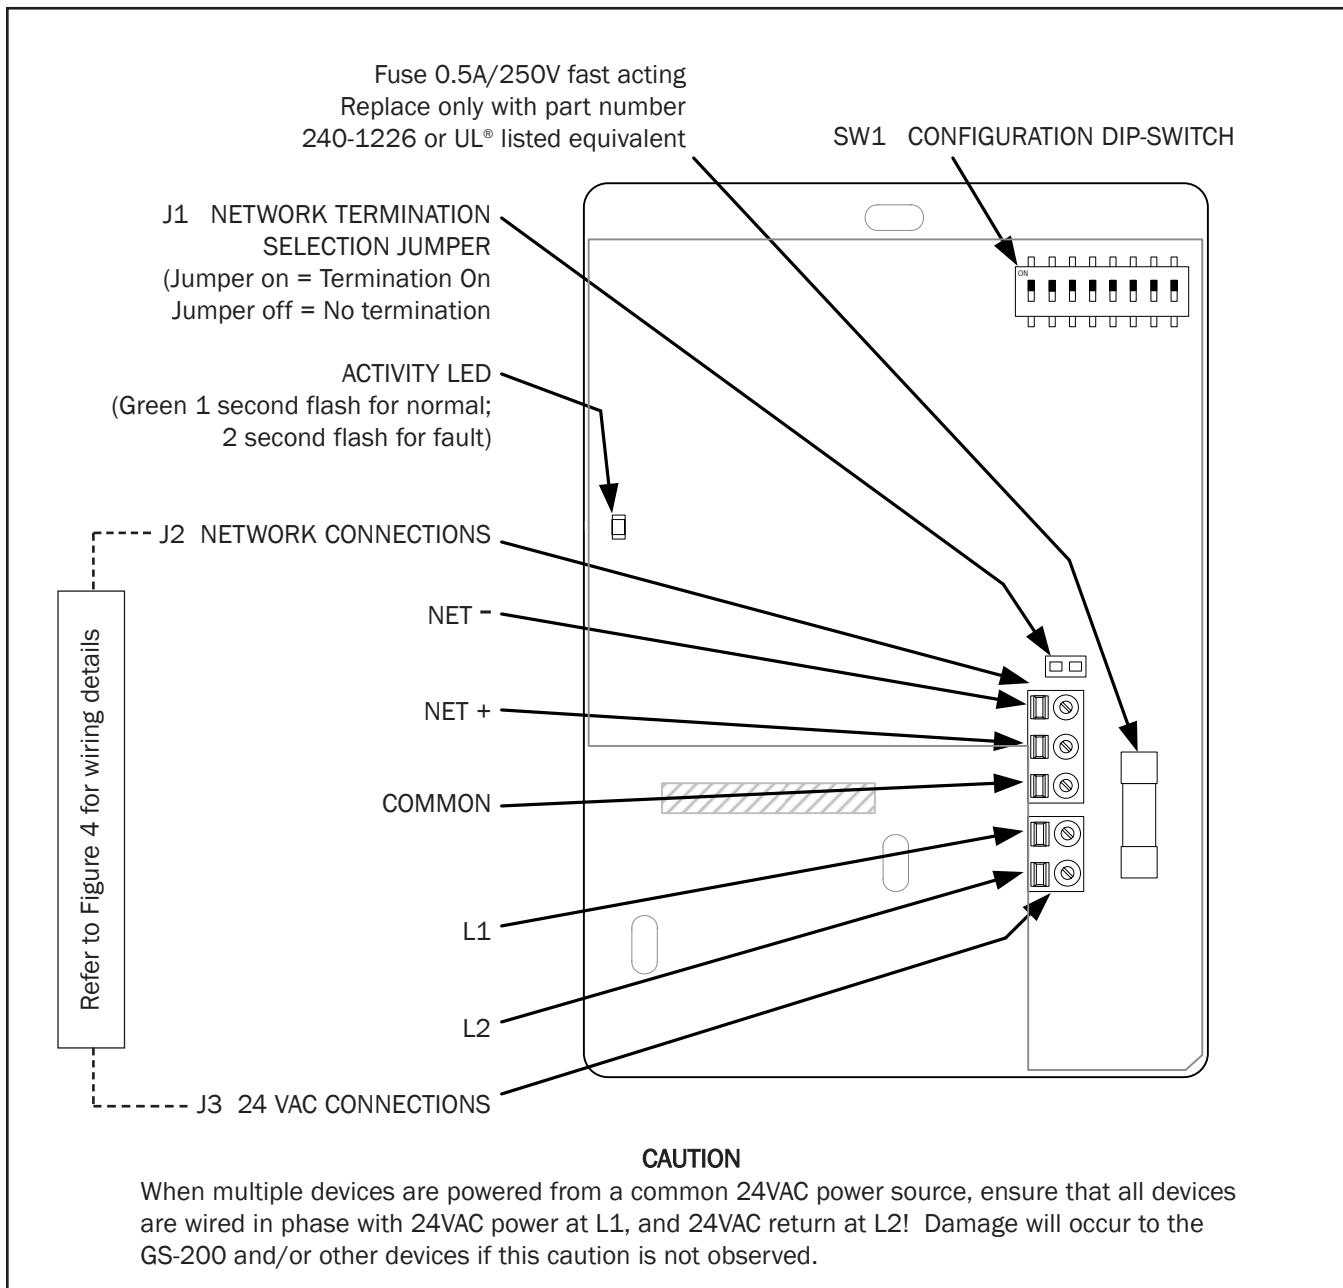

**Figure 5. GS-200 Interior Detail View**

## GS-200 SET UP

The GS-200 is shipped from the factory for BACnet operation. If Modbus operation is desired, proceed to the **GS-200 MODBUS CONFIGURATION** section of this document.

## GS-200 BACnet CONFIGURATION

The following paragraphs detail the initial set up instructions for the GS-200 when using BACnet device operation. Refer to Appendix A - GS-200 BACnet Device Operating Parameters for a detailed listing of all BACnet network variables and values.

### J1 - GS-200 RS485 Network Termination Selection

The GS-200 includes a network termination selection jumper at J1 (shown in Figure 4) to permit device installation at any point on an RS-485 network. When the GS-200 is located at either end of an RS-485 network or segment, it is recommended that the jumper at J1 be installed across both pins of J1. When the GS-200 is located at any other point on the RS-485 network, no termination is recommended, and the jumper should not be installed across J1.

### Setting GS-200 Time

It is not necessary to set the internal clock within the Model GS-200 prior to placing the device in operation, or in the event of loss of power to the instrument.

**Note:**

**When initially powered on (or following an interruption of 24 VAC power), the GS-200 internal time is set at 00:00:00 (midnight).**

Although not necessary, the GS-200 time setting may be re-synchronized with the network following a power loss or interruption. For BACnet applications, a timesync command (see Appendix A) may be sent to the GS-200 using appropriate network software. For Modbus applications, the current time (in hours and minutes) may be reset using appropriate network software at registers 30013 and 30014 respectively (see Appendix B).

### SW1 - GS-200 Configuration DIP Switch Settings


The configuration DIP switch contains eight separate dual-position switches in a dual inline package (DIP) as shown in Figures 5 and 6. These switches allow for setting the following GS-200 network parameters:

- Setting the MAC Address/Slave ID - using Switches 1 through 7
- Setting BACnet Device Object Instance Number (if the same as the MAC Address) - using Switch 8
- Setting BACnet Baud Rate - using Switches 1 through 4
- Restoring Defaults - using Switches 1-8
- Enabling Modbus network operation - using Switches 1 through 4

**NOTE:**

Prior to initializing the GS-200, the MAC address and the baud rate parameters must be assigned.

The following paragraphs provide detail for setting the network parameters using Configuration DIP Switch SW1.

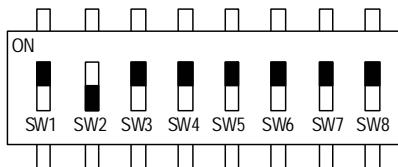

**Figure 6. SW1 - Configuration DIP Switch Detail View**

### Setting the MAC Address

The default GS-200 MAC Address is set at the factory for a value of 2. If it is necessary to change the MAC address use switches 1 through 7 of SW1 to set the MAC Address to set any network address between 1 and 127 as follows:

1. Deactivate 24VAC power to the GS-200.
2. Set SW1 switches 1-7 to the desired address as shown in Figure 7. Record the new MAC address value for future reference.
3. Reapply 24VAC power to the GS-200. After a short delay (approximately 20 seconds) the new MAC address is now active.

MAC ADDRESS SETTINGS								
SW1 DIP Switches 1-7								
DIP Switch Number and Position								Network Address
1	2	3	4	5	6	7	8	
off	off	off	off	off	off	off	off	0
on	off	1						
off	on	off	off	off	off	off	off	2
on	on	off	off	off	off	off	off	3
↓	↓	↓	↓	↓	↓	↓	↓	
on	on	on	on	on	on	on	off	127

Only SW1 Switches 1 through 7 are used to set the MAC Address - See text for detail.

**Figure 7. MAC Address Selection Settings**

#### NOTE:

When GS-200 configuration is completed, confirm that the new MAC address has been set correctly using appropriate BACnet software

### Changing BACnet Device Object Instance Number

The BACnet Device Object Instance Number is set at the factory to match the factory default address of 2. If necessary, the BACnet Device Object Instance Number can be set to match the user assigned MAC address as follows:

1. Deactivate 24VAC power to the GS-200.
2. Slide DIP Switch 8 to the ON position.
3. Restore 24VAC power to the GS-200. Allow a short delay (approximately 20 seconds) for the new BACnet Device Object Instance Number to be recognized.
4. Restore DIP Switch 8 to the OFF position.

The BACnet Device Object Instance Number can also be set to another value that does not match the MAC address by using suitable BACnet software to write to the Device Object Identifier property of the Device Object. Refer to Appendix A for additional detail.

## Setting the MS/TP Baud Rate

The GS-200 is shipped from the factory for BACnet operation with a baud rate of 76,800bps. The baud rate can be changed to 38,400, 19,200 or 9,600bps. Changes can be accomplished remotely over the network using BACnet Analog Value AV1 (Table A3), or locally at the GS-200 by using internal DIP Switch SW1 as follows:

1. Record the currently assigned MAC Address (SW1 switches 1 through 7 - See Figure 7).
2. Set the desired baud rate using Address Switches 1 through 4 as shown in Figure 8.

**Baud Rate Selection**  
SW1 DIP Switches 1-4

ADDRESS DIP Switch Number/Position								MS/TP Baud Rate
1	2	3	4	5	6	7	8	
on	off	off	off	X	X	X	X	76,800
off	on	off	off	X	X	X	X	38,400
off	off	on	off	X	X	X	X	19,200
off	off	off	on	X	X	X	X	9,600

**Only SW1 Switches 1 through 4 are used to set the Baud Rate - See text for detail.**

**Figure 8. Baud Rate Selection Settings**

3. Set DIP Switch 8 to the ON position. Allow a short delay (approximately 20 seconds) for the new baud rate to be recognized.
4. Restore DIP Switch 8 to the OFF position.
5. Restore DIP switches 1-7 to the MAC address recorded in step 1.

## Restoring Factory Default Settings

The following procedure can be used to restore the factory default settings to the GS-200:

1. If the current MAC Address will be reused, record the currently assigned address (SW1 switches 1 through 7 - see Figure 7).
2. Deactivate 24VAC power to the GS-200.
3. Set all 8 of the DIP switches (1-8) to the ON position.
4. Restore 24VAC power to the GS-200. Allow a short delay (approximately 20 seconds) for the factory default settings to be recognized.
5. Deactivate 24VAC power to the GS-200.
6. Set all 8 of the DIP switches (1-8) to the OFF position.
7. Restore DIP switches 1-7 to the MAC address recorded in step 1.
8. Restore 24VAC power to the GS-200 to return it to service with factory default settings.

## GS-200 MODBUS CONFIGURATION

The GS-200 is preset at the factory for BACnet network operation. To set the GS-200 for Modbus network operation, perform the following steps. Refer to Appendix B - GS-200 MODBUS Device Operating Parameters for a detailed listing of Modbus network register values and settings.

1. The default network address is set at the factory for a value of 2. Any value between 1 and 127 can be assigned for the GS-200 using Configuration DIP Switch SW1 as outlined in the **Setting the MAC Address** paragraph of this document. If the current network address will be reused, record the current settings of DIP switches 1 through 7.
2. With the GS-200 powered on, set Configuration DIP switches 1 through 4 to the ON position.
3. Toggle DIP switch 8 to the ON position for 5 seconds, and then back to OFF.

4. Restore DIP switches 1-7 to the network address recorded in step 1.
5. The GS-200 is now set for Modbus operation with a baud rate of 19,200bps. If necessary, the baud rate can be changed as outlined previously in the **Setting the Baud Rate** paragraph of this document.
6. Configure the necessary Modbus register values as outlined in Appendix B.

## GS-200 START-UP

The following procedure is intended for initial start up of the instrument.

1. Confirm that the GS-200 is installed and wired properly as outlined in **GS-200 INSTALLATION** and **GS-200 INTERCONNECTIONS** sections of this document.
2. Confirm that network termination, address, baud rate and device object instance number (as applicable) have all been properly set as outlined previously in the **GS-200 BACnet CONFIGURATION** or **GS-200 MODBUS CONFIGURATION** sections of this document.
3. Apply 24VAC power to the GS-200. After a brief initialization (approximately 20 seconds) observe that the green Activity LED flashes on for 1 second, then OFF for one second indicating normal operation.
4. Install GS-200 cover by engaging the small molded hinges at the top of the cover with the base, and then gently swinging the cover downward into the closed position. The cover will latch via the tab located at the bottom of the enclosure. If required, install Security/Tamper resist screw at the bottom of the GS-200 enclosure (as shown in Figure 3).
5. Confirm network device settings and operation using Appendices A and B for BACnet and Modbus applications respectively.
6. The GS-200 is now ready for normal network operation.

## GS-200 NORMAL OPERATION

During normal operation of the GS-200, no further user activity is required.

The GS-200 features a green “Activity” light emitting diode (LED - see Figure 5) that flashes to indicate the operating status of the instrument. Following application of 24VAC power and a brief instrument initialization of approximately 20 seconds, the LED will begin to flash.

During normal GS-200 operation the Activity LED will continuously flash ON for 1 second, then OFF for 1 second.

During GS-200 fault conditions, the LED will continuously flash ON for 2 seconds, and then OFF for 2 seconds.

Refer to Appendix A and Appendix B for BACnet and Modbus device network values available during operation of the GS-200.

## GS-200 MAINTENANCE

In most HVAC environments, periodic maintenance and calibration are not required or recommended.

## GREENTROL STANDARD LIMITED PARTS WARRANTY

Greentrol products are warranted for 12 months from shipment. Product will be repaired/replaced free of charge as described in the Terms and Conditions of Sale.

## APPENDIX A - BACnet NETWORK DEVICE OPERATING PARAMETERS

### GS-200 BACNET OVERVIEW

The BACnet objects associated with the GS-200 permit display of current values and device configuration. The BACnet object categories for the GS-200 (below) are described in the following paragraphs.

- BACnet Device Object
- BACnet Analog Input (AI) Objects
- BACnet Analog Value (AV) Objects
- BACnet Binary Value Objects

#### BACnet Device Object

The device object allows configuration of the GS-200. Object properties can be specified as shown in Table A1.

Table A1. BACnet Device Object

BACnet Object	Description
GS-200-RH/T	This object allows the operator to specify the following: Device name Device location Time and Date Universal Time Coordinated Offset APDU properties MS/TP properties Object Identifier

#### BACnet Analog Input (AI) Objects

The analog input BACnet objects permit display of the present values for the items detailed in Table A2. In addition, analog input change of value (AI COV) subscriptions for these objects can be configured as follows:

AI COV: A confirmed or unconfirmed COV (Change of Value) notification can be subscribed to for each analog input object (below). The COV increment value can be set through each AI.

Table A2. BACnet Analog Input (AI) Objects

BACnet Object	Default Present-Value	Range	Description
RH (AI1)	Display Only	NA	Displays the present value of relative humidity in percent.
Temperature (AI2)	Display Only	NA	Displays the present value of ambient room temperature in degrees F (can be changed to degrees C if desired).

## BACnet Analog Value Objects

The analog value BACnet objects allow for configuration of variables that affect instrument operation and individual sensor measurement accuracy.

**Table A3. BACnet Analog Value Objects**

BACnet Object	Default Present-Value	Range	Description
Baud Rate (AV1)	76,800	Optional	This object allows specifying the RS485 Baud rate.
Relative Humidity Gain (AV2)	1	0 - 100	This object allows specifying a gain to the raw Relative Humidity sensor reading or to the GreenTrol factory calibration gain adjustment setting.
Temperature Gain (AV3)	1	0 - 100	This object allows specifying a gain to raw Temperature sensor reading or to the GreenTrol factory calibration gain adjustment setting.
Relative Humidity Offset (AV4)	0	+/-100	This object allows specifying an offset to raw Relative Humidity sensor reading or to the GreenTrol factory calibration offset adjustment setting.
Temperature Offset (AV5)	0	+/-200	This object allows specifying an offset to raw Temperature sensor reading or to the GreenTrol factory calibration offset adjustment setting.

## BACnet Binary Value Objects

The binary value BACnet objects allow for application of the GreenTrol factory calibration values for individual sensor gain and offset factors.

## **APPENDIX B - MODBUS NETWORK DEVICE OPERATING PARAMETERS**

**Table A4. BACnet Binary Value Objects**

BACnet Object	Default Present-Value	Range	Description
Factory Relative Humidity Gain/Offset Status (BV1)	Active	Active/ Inactive	When this object is set to Active, the Relative Humidity sensor will operate with the GreenTrol factory calibration values for gain and offset.
Factory Temperature Gain/Offset Status (BV2)	Active	Active/ Inactive	When this object is set to Active, the Temperature sensor will operate with the GreenTrol factory calibration values for gain and offset.

## **GS-200 Modbus Register Overview**

For Modbus, all communication is 8 Data Bits, 1 Stop Bit and no parity. The Modbus registers associated with the GS-200 permit display of current values and device configuration. They are grouped into the following categories:

Read-only registers consisting of three 4-byte floats (high word/low word) detailed in Table B2.

Read/write registers consisting of seven 4-byte floats (high word/low word) detailed in Table B3.

Read/write 2-byte registers detailed in Table B4.

Table B1 identifies the GS-200 supported standard Modbus command functions.

**Table B1. GS-200 Supported Standard Modbus Command Functions**

Command	Description
04	Read input registers (refer to Tables B2 through B4).
06	Write registers (refer to Tables B2 through B4).
16	Write multiple registers (refer to Tables B2 through B4).

### **Modbus 4-Byte Floats - Read Only Properties**

The 4-byte floats with read only properties permit display of each of the sensors values in the GS-200 as detailed in Table B2.

### **Modbus 4-Byte Floats - Read/Write Properties**

The 4-byte floats with read and write properties detailed in Table B3 allow the configuration of gain and offset variables that affect the measurement accuracy of the sensors.

**Table B2. Modbus 4-Byte Floats - Read-Only Properties**

Name	Address	Default Register Value	Range	Description
Present Relative Humidity	30001 - 30002	Display Only	NA	These paired registers contain the present relative humidity percentage.
Present Temperature	30003 - 30004	Display Only	NA	These paired registers contain the present ambient room temperature in degrees F.

### **Modbus 2-Byte Registers - Read/Write Properties**

The 2-byte registers with read and write properties detailed in Table B4 allow configuration of the variables that affect the accuracy of the sensors.

**Table B3. Modbus 4-Byte Floats - Read/Write Properties**

Name	Address	Default Register Value	Range	Description
Relative Humidity Gain	30005 - 30006	1	0 - 100	These paired registers allow specifying a gain value to the raw Relative Humidity sensor reading or to the GreenTrol factory gain adjustment setting.
Temperature Gain	30007 - 30008	1	0 - 100	These paired registers allow specifying a gain value to the raw Temperature sensor reading or to the GreenTrol factory gain adjustment setting.
Relative Humidity Offset	30009 - 30010	0	+/-100	These paired registers allow specifying an offset value to the raw Relative Humidity sensor reading or to the GreenTrol factory offset adjustment setting.
Temperature Offset	30011 - 30012	0	+/-200	These paired registers allow specifying an offset value to the raw Temperature sensor reading or to the GreenTrol factory offset adjustment setting.

**Table B4. Modbus 2-Byte Registers - Read/Write Properties**

Name	Address	Default Register Value	Range	Description
GS-200 Time: Hours	30013	0	0 - 23	This register allows setting the current hour of time.
GS-200 Time: Minutes	30014	0	0 - 59	This register allows setting the current minute of time.
Float Invert	30015	0	0 or 1	This register allows change to the order of register that is read or written first in the 4-byte floats. When this register is set to 0 (default) the high word is read or written first; when it is set to 1 the low word is read or written first.
Factory Relative Humidity Gain/Offset Status	30016	1	1 or 0	When this register is set to 1 (default) the Relative Humidity sensor operates with GreenTrol factory gain and offset adjustment. When this register is set to 0, the Relative Humidity sensor operates without factory gain and offset adjustment.
Factory Temperature Gain/Offset Status	30017	1	1 or 0	When this register is set to 1 (default) the Temperature sensor operates with GreenTrol factory gain and offset adjustment. When this register is set to 0, the Temperature sensor operates without GreenTrol factory gain and offset adjustment.
Temperature Units of Measurement Units	30018	0	0 or 1	This register allows setting the temperature measurement units of register 30003/30004 to Fahrenheit or Celsius. When this register is set to 0 (default) the unit of temperature measurement is Fahrenheit. When set to 1, the unit of temperature measurement is Celsius.

